



Ground-Recessed Luminaire **BES III/10 LED**



In order to ensure a proper installation and for your safety, please observe the following instructions. The installation of a ground-recessed luminaire is only be done by a qualified technical expert. Please note that the lines do not carry any voltage. The product is completely recyclable and should not be disposed with normal household waste!

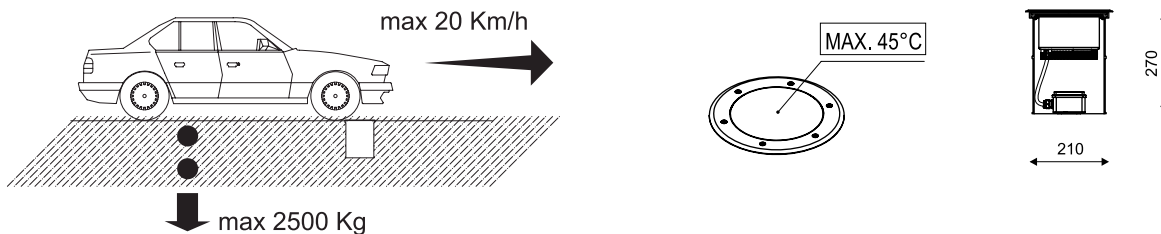



Prior to the installation, please ensure that the glass plate is not damaged (if necessary, replace it)

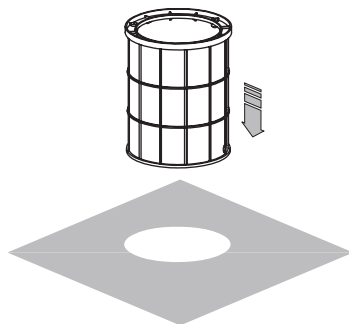


Take off the sump. Put the sump in the ground and harden it. Ensure that the ground-recessed luminaire is never exposed to standing water. It is essential to have a well-functioning drainage.



The in-ground recessed spotlight is supplied with a 0.4 m cable (3 × 1.5 mm²) already attached. The cable gland is suitable for cable with 5 to 10mm diameter. We caution you that the guarantee is not applicable in case of connecting a non-Leipziger Leuchten cable because we cannot guarantee a proper connection of that cable and hence, the tightness of the ground-recessed luminaire.

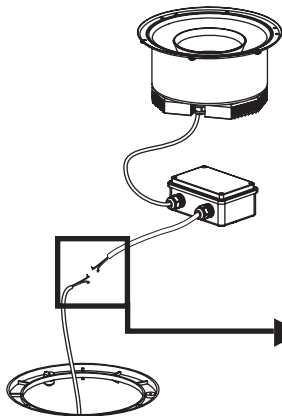

Insert the ground-recessed luminaire in the sump and pass the cable.

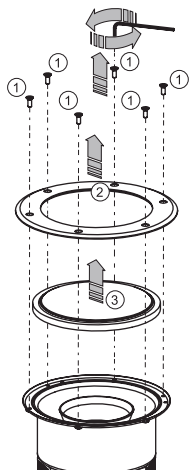

Opening and closing the BES III/10 LED - if required. For this purpose, loosen 6 pcs. screws on the outer ring and take off the outer ring including glazing. Close the luminaire in retrospective application. Please examine that all sealings are properly seated and all screws are properly tightened; to ensure the protection degree IP 67.